

## Record of the Vaccine Storage Refrigerator

Doctors enrolled in VSS have to use Purpose-built vaccine refrigerators (PBVR) for vaccine storage. For further details regarding vaccine storage under VSS, please refer to Chapter 6 of the VSS Doctor's Guide – Requirements on vaccine storage and handling under VSS


([https://www.chp.gov.hk/files/pdf/vssdg\\_ch6\\_vaccine\\_storage\\_and\\_handling.pdf](https://www.chp.gov.hk/files/pdf/vssdg_ch6_vaccine_storage_and_handling.pdf)).

**For record and follow-up purpose, please complete this form, supplemented with:-**

- (1) One photo of the interior of the refrigerator **currently** used for vaccine storage at your clinic; and
- (2) One photo of the temperature monitoring device AND temperature record

Should you have any enquiries **regarding PBVR**, please contact 3975 4839 or 3975 4845.

### (1) Photo of the interior of the refrigerator and Max-min thermometer

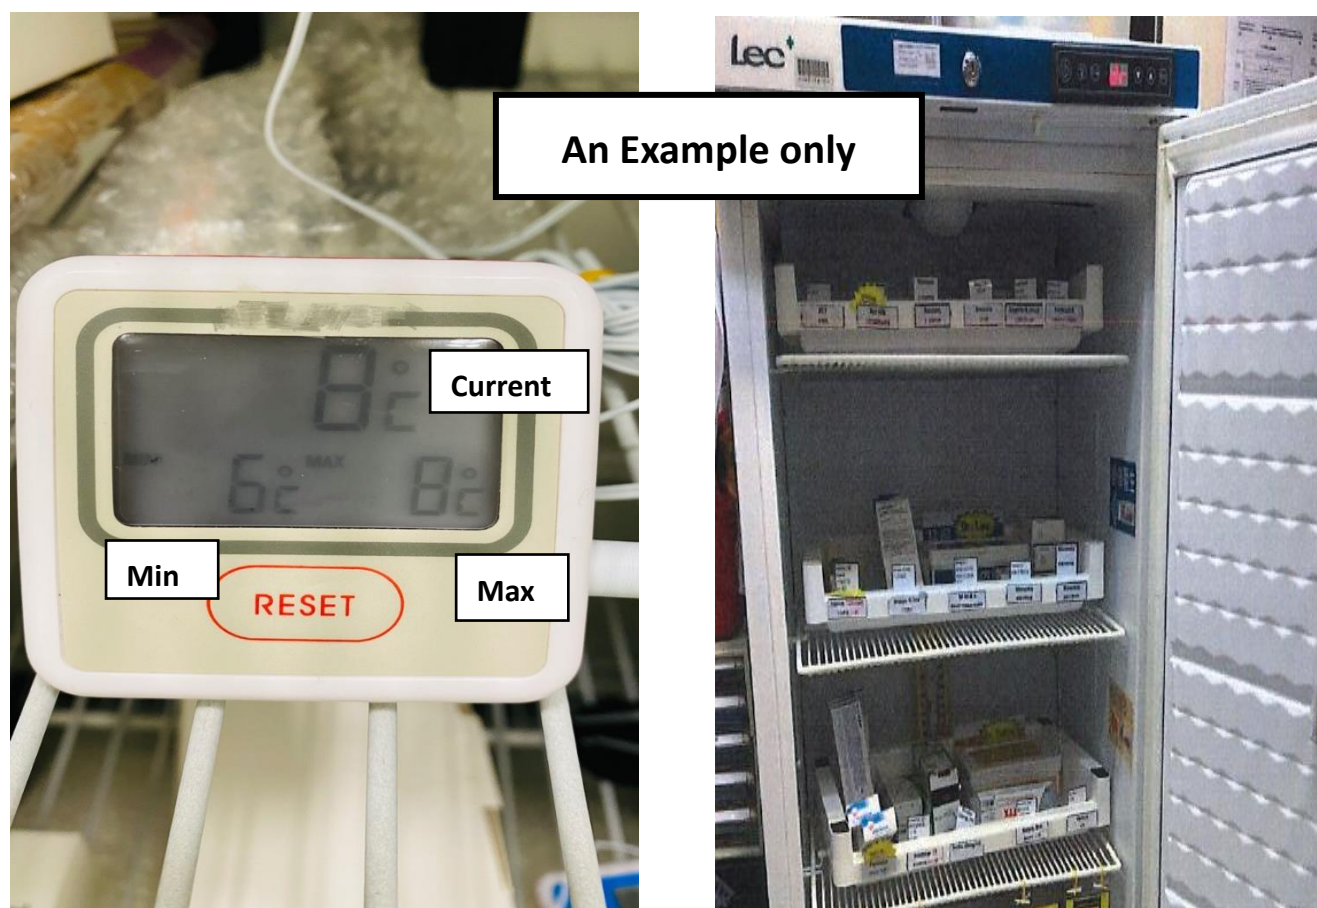

Fridge Brand Name: \_\_\_\_\_

Fridge Model No.: \_\_\_\_\_

Doctor's Name: \_\_\_\_\_

Practice Name and No.: \_\_\_\_\_

eHR UID: \_\_\_\_\_

Contact Phone number: \_\_\_\_\_

Signature: \_\_\_\_\_

Date: \_\_\_\_\_

(2) Photo or copy of the temperature record kept in the clinic

貯存疫苗的雪櫃溫度檢查表

An Example only

1. 所有疫苗（季節性流感疫苗及肺炎球菌疫苗），須保存於攝氏 +2°C 至 +8°C 雪櫃內備用。
2. 必須使用疫苗專用雪櫃，切勿使用家用雪櫃或一般小型單門雪櫃貯存疫苗。
3. 除非雪櫃有內置儀器可以自動生成／下載溫度記錄，否則每日須檢查 兩次（上、下午 各一次）雪櫃內的現時、最高及最低溫度，並記錄在本表格上。請於每次記錄雪櫃溫度後，重置最高最低溫度計。
4. 請保留此記錄至少一年，以便有需要時作參考。

\*\*註：如雪櫃溫度 低於攝氏+2 度或高於攝氏+8 度，

1. 請暫勿使用受影響的疫苗，並應將疫苗立即存放於攝氏+2 度至+8 度的雪櫃。
2. 請通知診所醫生及向疫苗供應商查詢
3. 在‘溫度超溫事故報告表’填寫有關事故並傳真至項目管理及疫苗計劃科: 2544 3927 (傳真號碼)。

| 日期 | 檢查<br>雪櫃<br>時間 | 雪櫃內溫度（攝氏/°C） |    |    | 記錄人員 |    |    | 備註<br>（如通知醫生及向疫苗<br>供應商查詢：雪櫃溫度<br>低於攝氏+2 度或高於攝<br>氏+8 度） |
|----|----------------|--------------|----|----|------|----|----|----------------------------------------------------------|
|    |                | 現時           | 最高 | 最低 | 姓名   | 職位 | 簽署 |                                                          |
|    |                |              |    |    |      |    |    |                                                          |
|    |                |              |    |    |      |    |    |                                                          |
|    |                |              |    |    |      |    |    |                                                          |
|    |                |              |    |    |      |    |    |                                                          |
|    |                |              |    |    |      |    |    |                                                          |
|    |                |              |    |    |      |    |    |                                                          |
|    |                |              |    |    |      |    |    |                                                          |
|    |                |              |    |    |      |    |    |                                                          |
|    |                |              |    |    |      |    |    |                                                          |
|    |                |              |    |    |      |    |    |                                                          |